


HWL Temporary Meter Pole Specifications

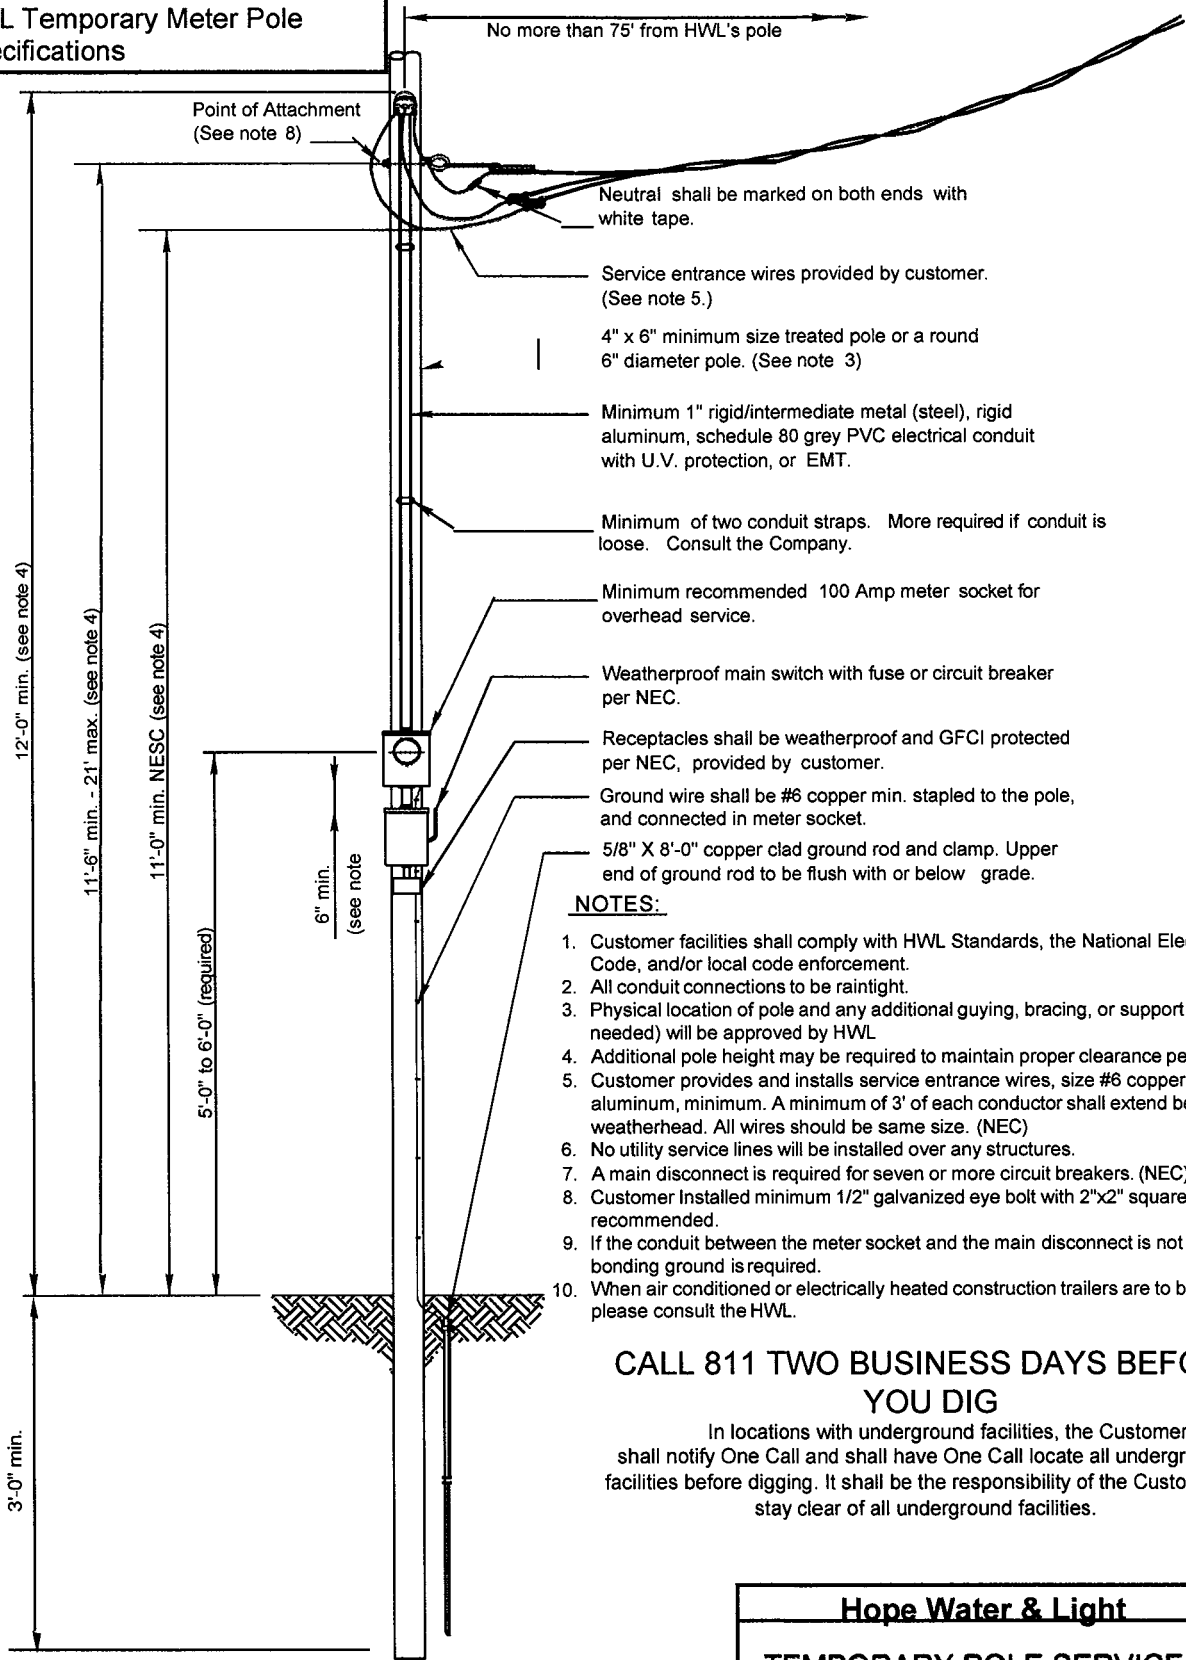

NOTES:

1. Customer facilities shall comply with HWL Standards, the National Electrical Code, and/or local code enforcement.
2. All conduit connections to be raintight.
3. Physical location of pole and any additional guying, bracing, or support (if needed) will be approved by HWL
4. Additional pole height may be required to maintain proper clearance per NESC
5. Customer provides and installs service entrance wires, size #6 copper or #4 aluminum, minimum. A minimum of 3' of each conductor shall extend beyond the weatherhead. All wires should be same size. (NEC)
6. No utility service lines will be installed over any structures.
7. A main disconnect is required for seven or more circuit breakers. (NEC)
8. Customer Installed minimum 1/2" galvanized eye bolt with 2"x2" square washer recommended.
9. If the conduit between the meter socket and the main disconnect is not metal, a bonding ground is required.
10. When air conditioned or electrically heated construction trailers are to be served please consult the HWL.

CALL 811 TWO BUSINESS DAYS BEFORE YOU DIG

In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

Hope Water & Light	
TEMPORARY POLE SERVICE FROM AN OVERHEAD SOURCE	
APPROVED BY:	DATE: 10/27/17
CHECKED BY:	
DRAWN BY: S7	
SH. 1 OF 2	